
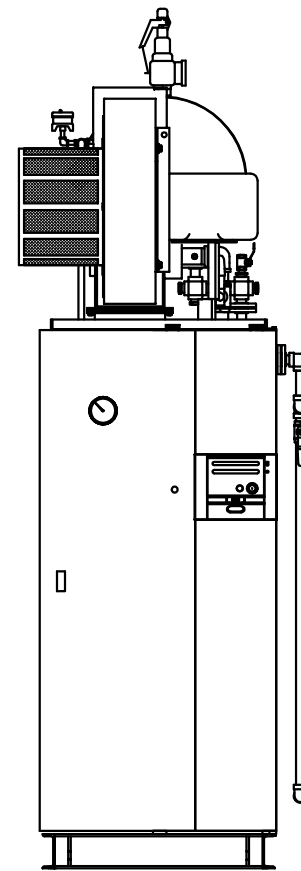
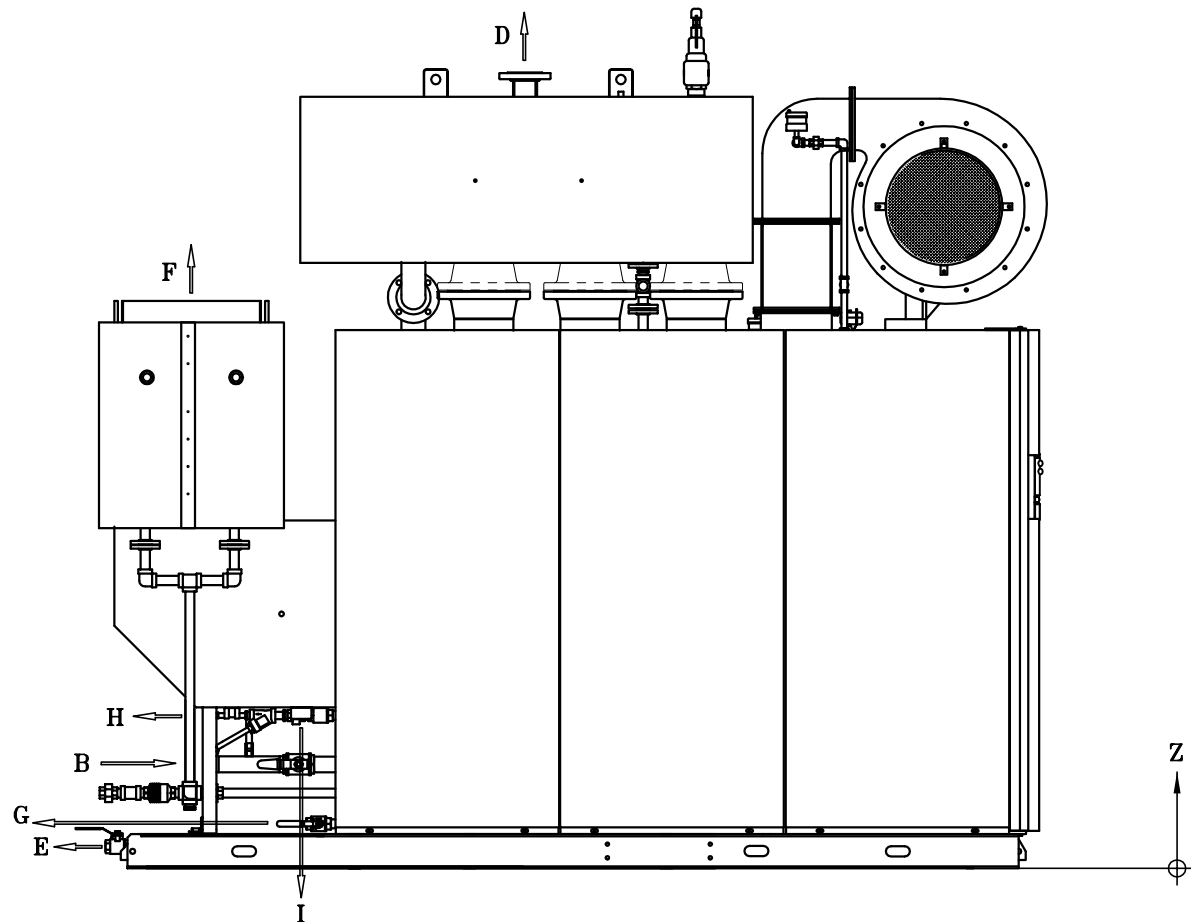


| | |
|-------------|-----|
| APP. TYPE | QTY |
| LX-200SG-07 | 1 |

NOTE:

- 1) THIS DRAWING ILLUSTRATED WITH AN ECONOMIZER.
- 2) DIMENSIONS, SPECIFICATIONS AND SOME PIPINGS ARE SUBJECT TO CHANGE WITHOUT NOTICE.
- 3) GAS VENT PIPING SHALL BE ENFORCED IN ACCORDANCE WITH LOCAL REGULATION.

| LEGEND | DIMENSION (INCHES) | | | |
|----------------------------|--------------------|--------|--------|-------------|
| | X | Y | Z | SIZE |
| A FEEDWATER INLET | 134 | 38 1/8 | 11 | 1" NPT |
| B SUPPLY GAS INLET | 117 3/4 | 25 7/8 | 15 1/8 | 2" NPT |
| C MAIN SAFETY VALVE OUTLET | 47 | 20 7/8 | 116 | 2 1/2" NPT |
| D STEAM OUTLET | 72 | 17 1/2 | 116 | 3" FLANGE |
| E BOTTOM BLOW-OFF | 133 1/4 | 12 3/4 | 3 1/4 | 1" NPT |
| F FLUE GAS OUTLET | 120 7/8 | 17 | 82 3/4 | ø20"ID DUCT |
| G L. V. CONTROL BLOW-OFF | 66 3/8 | 29 | 6 1/2 | 1" NPT |
| H AUTOMATIC BLOWDOWN | 118 5/8 | 29 1/8 | 22 1/4 | 3/8" NPT |
| I ECONOMIZER DRAIN | 104 5/8 | 12 3/4 | 21 5/8 | 2" NPT |
| O BOILER CORNER | 0 | 0 | 0 | - |

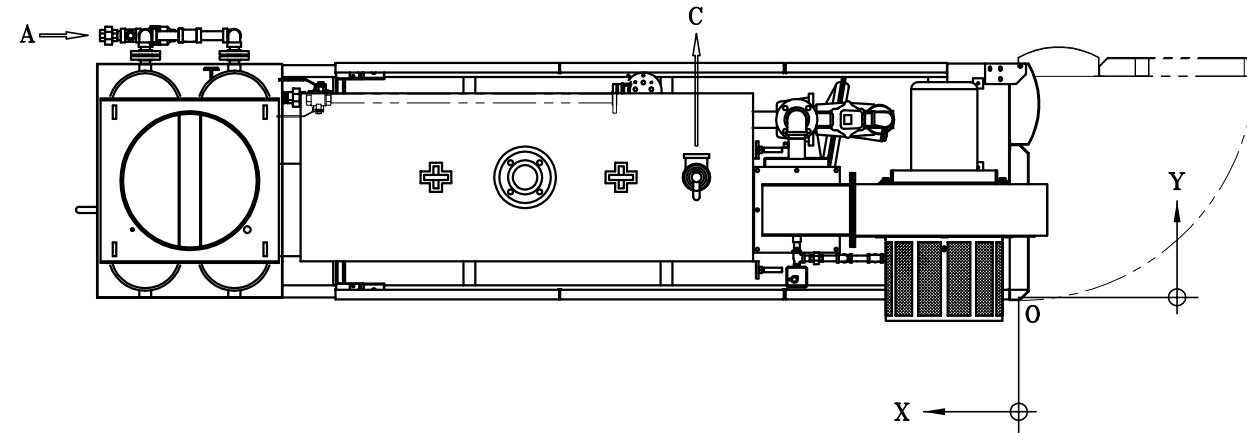

| | | | | |
|------------|--------------|------------|--------------|---------------------|
| NO | NAME OF PART | MATERIAL | QTY | REMARKS / DRAWING # |
| DWN.: ALAN | CK'D.: | SCALE: NTS | DO NOT SCALE | |

| | | | | | | | | |
|---|---------------------------------------|----------|------|----|-----------------|--|--------------------|--|
| <p style="text-align: center;">" CONFIDENTIAL "</p> <p>THIS MATERIAL IS THE PROPERTY OF MIURA BOILER CO., LTD., AND MUST NOT BE REPRODUCED, PUBLISHED OR DISCLOSED TO OTHERS WITHOUT AUTHORIZATION.</p> | SYM | REVISION | DATE | BY | DATE: MAY 22,07 | APPROVED: | THIRD ANGLE SYSTEM | DIM'N SHOWN ARE INCH |
| | CAD DWG - NO MANUAL CHANGES PERMITTED | | | | | MIURA BOILER CO., LTD. <small>BRANTFORD, ONTARIO, CANADA</small> | | DESCRIPTION: ORIENTATION OF IN & OUTLET |